WIRING ANY 230VAC 3 CORE AND EARTH ACTUATOR
TO A THREE POSITION RETRACTIVE SWITCH

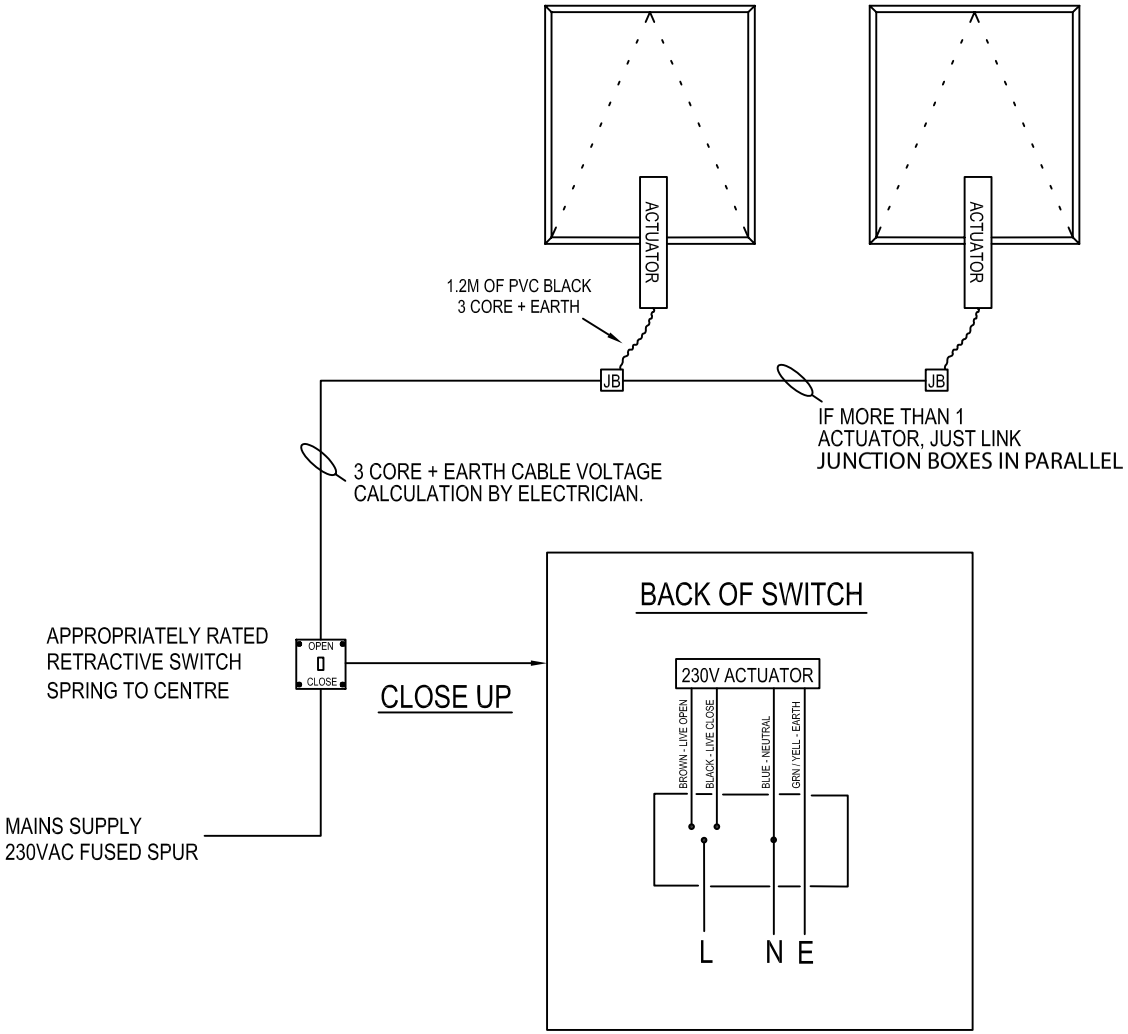

JUNCTION BOX MAY NEED TO BE
SUBSTITUTED BY AN ISOLATOR
UNDER 16TH EDITION WIRING REGULATIONS.

No.	Revision/Issue	Date

PERMANENT POWER MUST NEVER BE LEFT ON A MAINS VOLTAGE ACTUATOR

ROOFLIGHT ARCHITECTURAL LTD Tel: 01670 736124 e-mail: sales@rooflight.co.uk